

Group: (None)

Available From: 24.08.2020 00:00:00 Till: 02.12.2020 09:17:51

Displayed From: 01.11.2020 00:00:00 Till: 05.11.2020 09:16:29


Time (Ruler): 01.11.2020 00:51:57.825

Time (Server): 02.12.2020 09:17:51

Zoom time: 100.000%

Zoom Value: 100.000%

Text address	Long text	Current value	Unit	Current state	Value range 0%	Value range 100%	Ruler value	Ruler state
<input checked="" type="checkbox"/> HDPS:1 LNB10.CF001.XG001	Flow 1 Fish passages	724.06	l/s	Substituted	0.00	1000.00	745.63	Substitute...

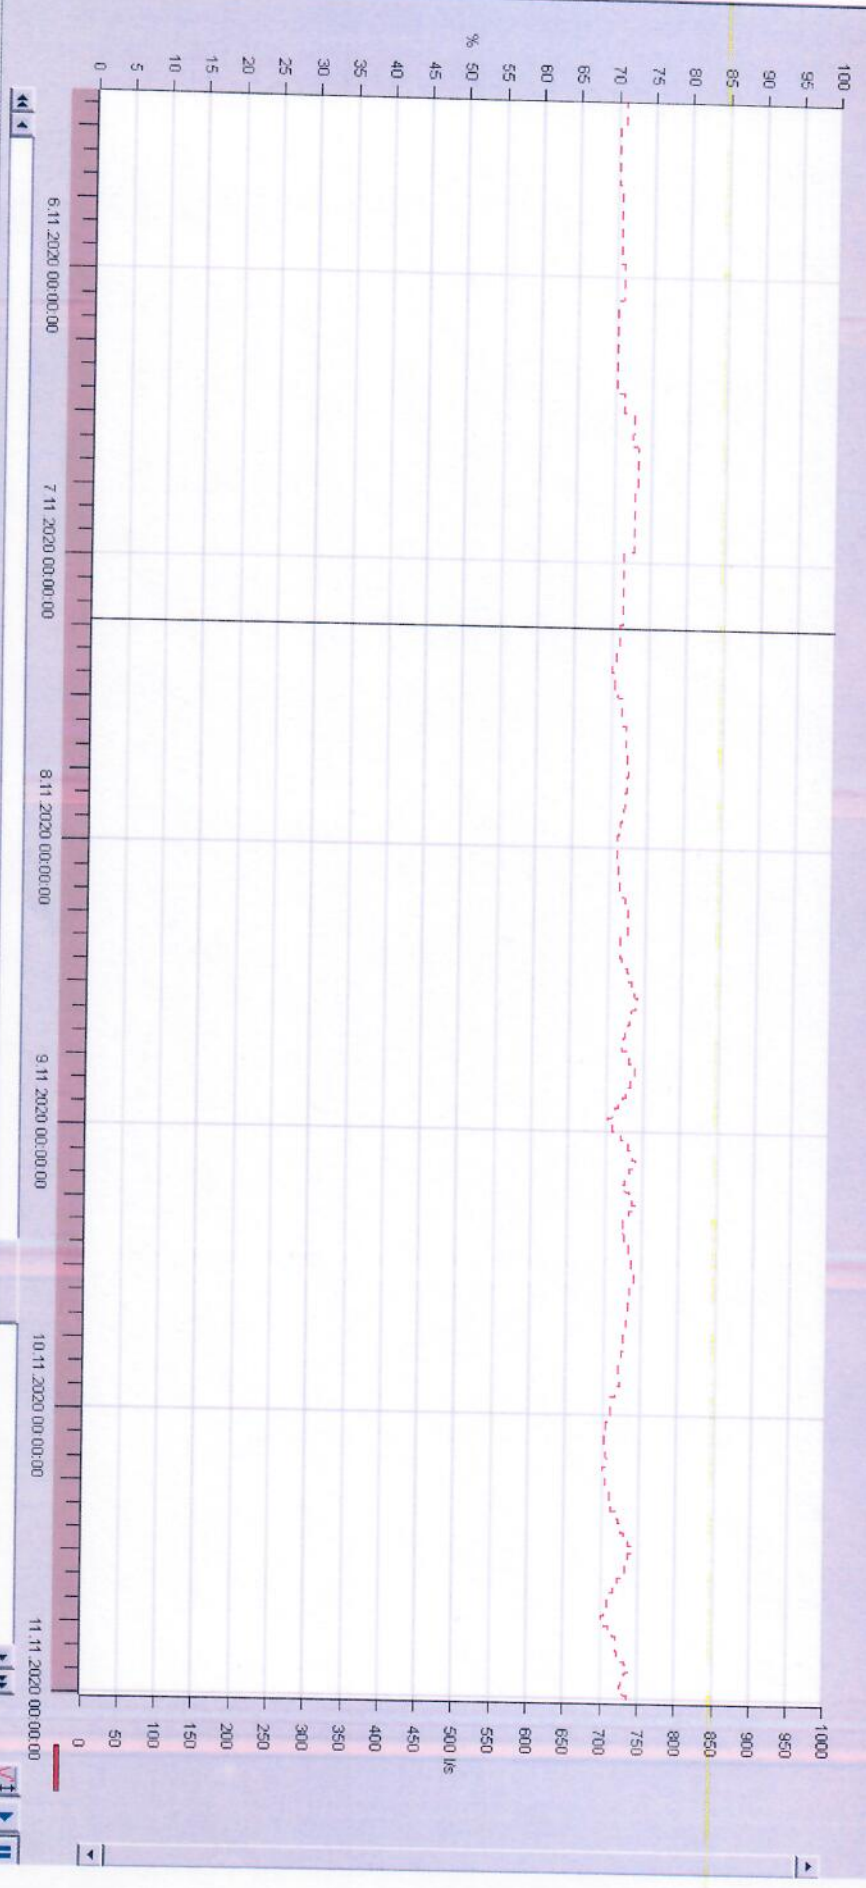

Group: (None)

Available From: 24.08.2020 00:00:00 Till: 02.12.2020 09:18:14

Displayed From: 05.11.2020 08:00:00 Till: 11.11.2020 00:16:29

Time (Ruler): 07.11.2020 05:23:27.176

Time (Server): 02.12.2020 09:18:14

Zoom time: 100.00%

Zoom Value: 100.00%

Test address	Long text	Current value	Unit	Current state	Value range 0%	Value range 100%	Ruler value	Ruler state
<input checked="" type="checkbox"/> HDR:1 LINB10.CP001.XC001	Flow 1 Fish passage	724.06	lbs	Substated	0.00	1000.00	709.75	Substrate...

DAR Switchgear

Electrical Overview

SWITCH-GEAR 110kV

SWITCH-GEAR 10kV

Auxiliary monitor Transmitters

SWITCH-GEAR 400V + DC


UNIT 1 TRAFU

UNIT 2 TRAFU

UNIT 3 TRAFU

UNITS Overall DAR


DAR

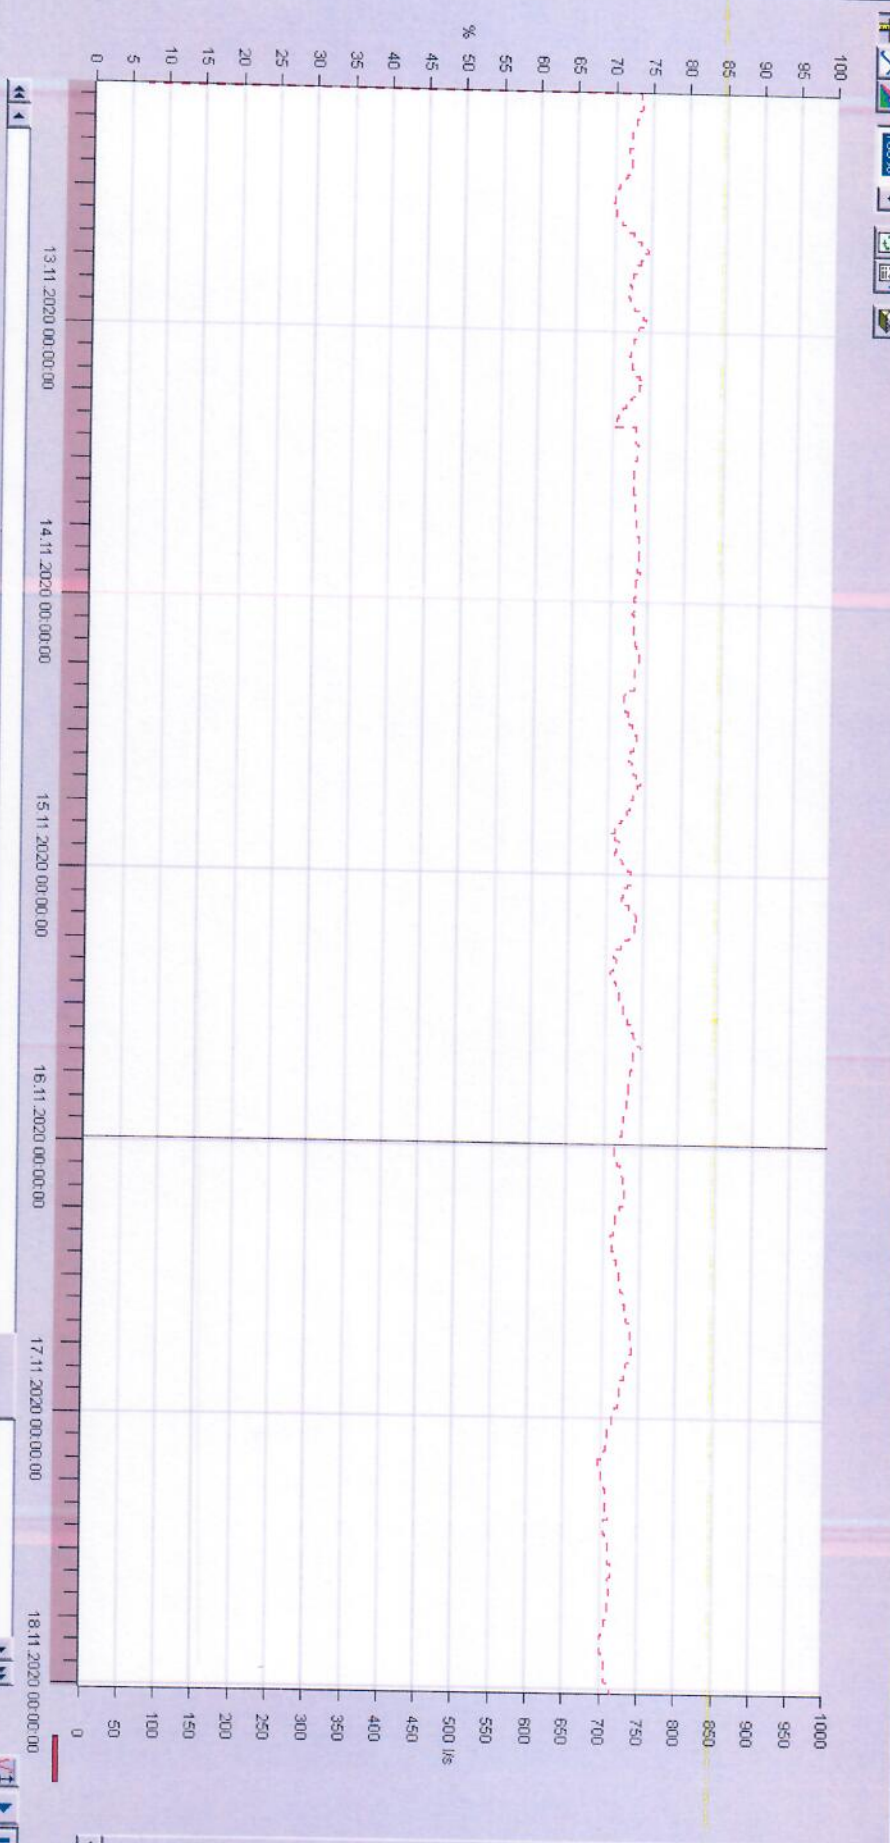

Group: (None)
Available From: 24.08.2020 00:00:00 TMR: 02.12.2020 09:19:26
Displayed From: 12.11.2020 03:00:00 TMR: 18.11.2020 00:16:29
Time (Ruler): 15.11.2020 23:35:25.697
Time (Server): 02.12.2020 09:19:26
Zoom time: 100.00%
Zoom Value: 100.00%

Text address	Long text	Current value	Unit	Current state	Value range 0%	Value range 100%	Ruler value	Ruler state
<input checked="" type="checkbox"/> HCR:1 LNB:0.CF:001.X:001	Flow: 1 Fish passage	724.06	l/s	Substituted	0.00	10000.00	720.00	Substitute...

DAR TOPO Electrical Overview SWITCH- GEAR 110kV SWITCH- GEAR 10kV Print number Transformers SWITCH- GEAR 400V + DC UNIT 1 TRAF0 UNIT 2 TRAF0 UNIT 3 TRAF0 UNITS Overall DAR NCC ST.SERVICE OVERVIEW

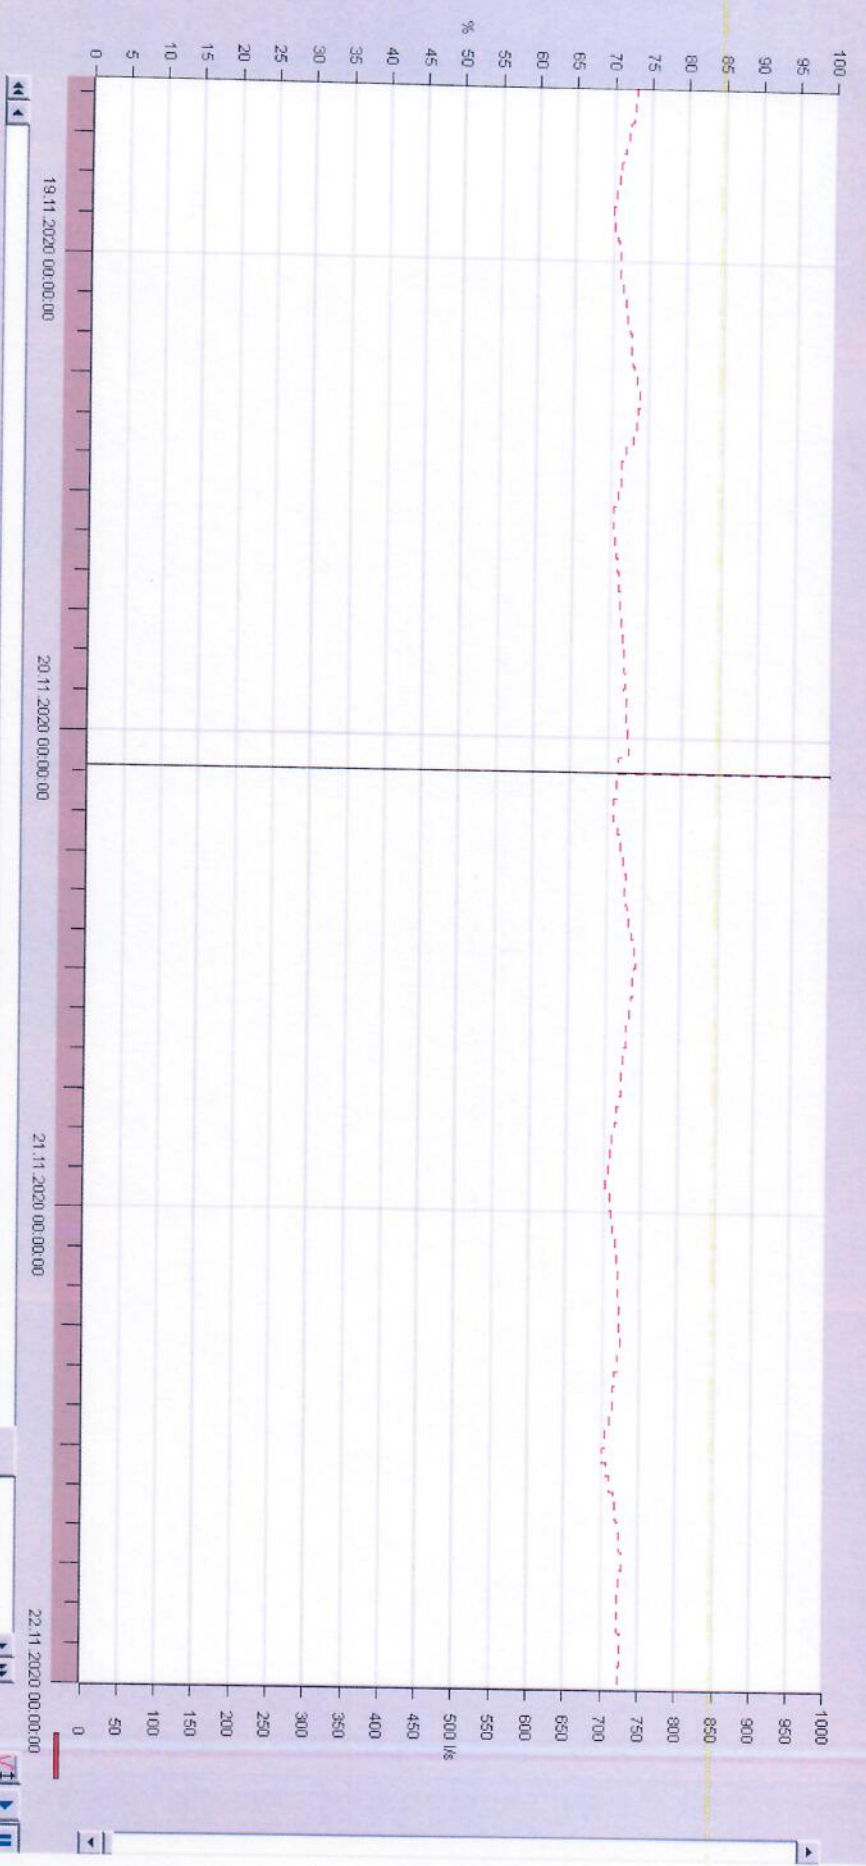

Group: (None)

Available From: 24.08.2020 00:00:00 Till: 02.12.2020 09:21:37

Displayed From: 18.11.2020 15:15:00 Till: 22.11.2020 00:00:29

Time (Ruler): 20.11.2020 01:38:58.861

Time (Server): 02.12.2020 09:21:37

Zoom time: 100.00%

Zoom Value: 100.00%

Text address	Long text	Current value	Unit	Current state	Value range 0%	Value range 100%	Ruler value	Ruler state
HDR:1 LNBT0.CF001.XQ01	Flow 1 Fish passage	724.06	l/s	Substituted	0.00	1000.00	714.35	Substitute...



DAR Switchgear

Electrical Overview

SWITCH-GEAR 110kV

SWITCH-GEAR 10kV

SWITCH-GEAR 400V + DC

UNIT 1 TRAF0

UNIT 2 TRAF0

UNIT 3 TRAF0

Print monitor


UNITS Overall DAR

NCC DAR

SERVICE OVERVIEW

DAR

Dariali Energy ANDRITZ Hydro

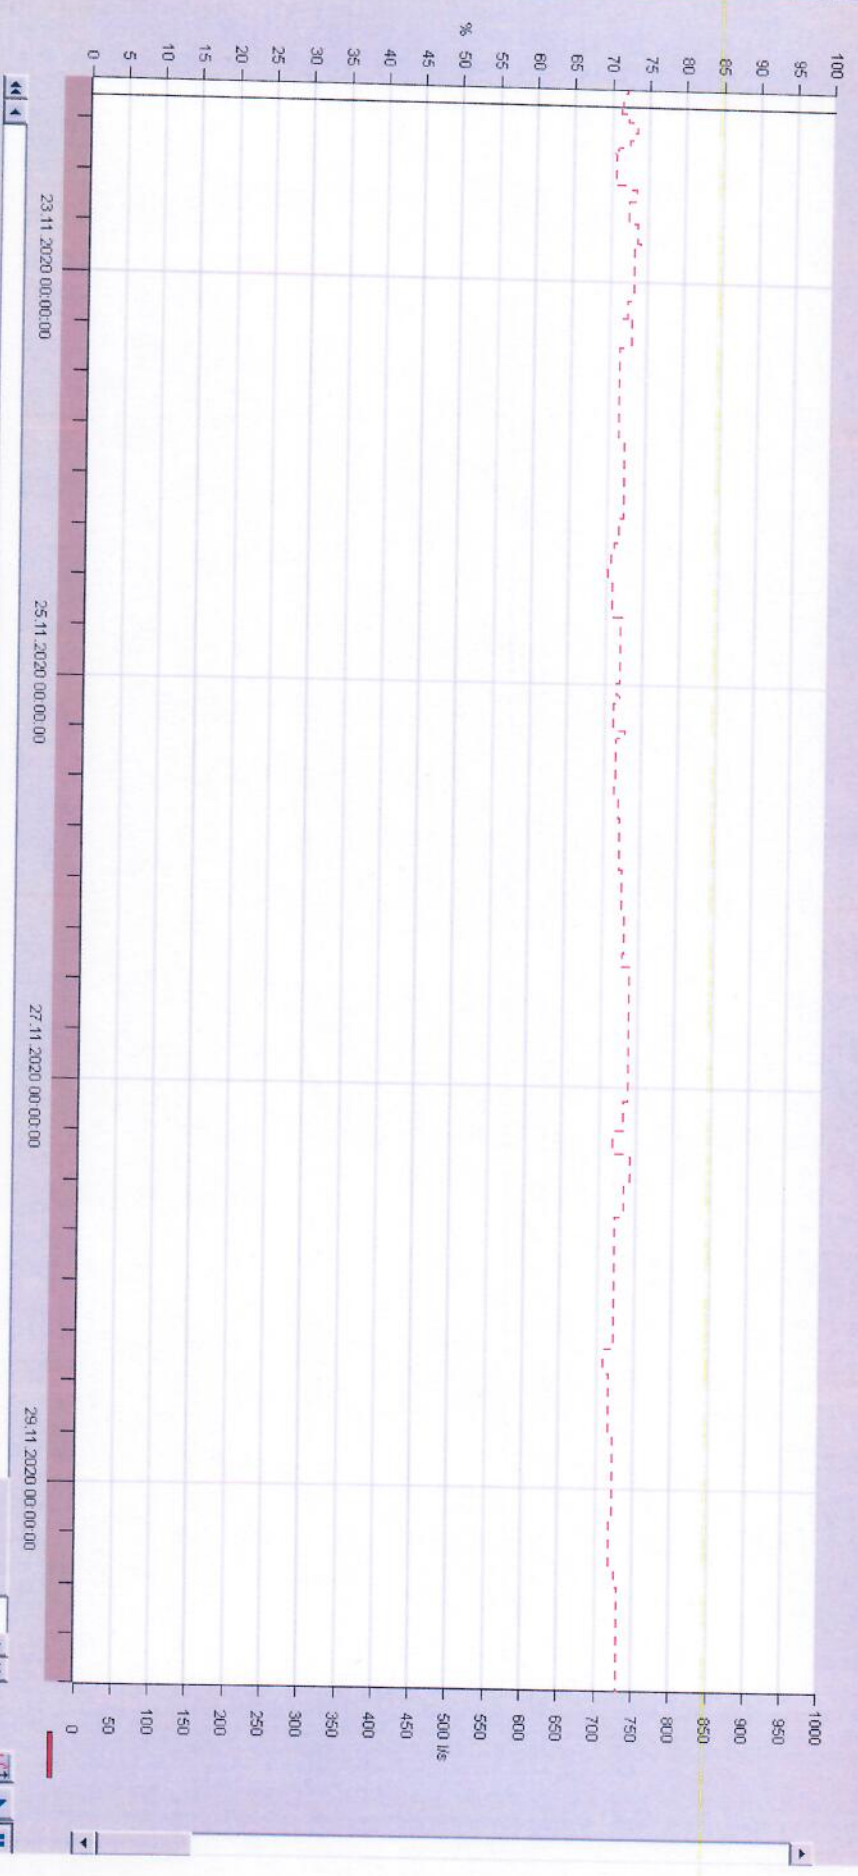

Group: (None)

Available From: 24.08.2020 00:00:00 TIL: 02.12.2020 08:22:28

Displayed From: 22.11.2020 01:15:00 TIL: 30.11.2020 00:00:29

Time (Ruler): 22.11.2020 03:10:04.953

Time (Server): 02.12.2020 09:22:28

Zoom time: 100.00%

Zoom Value: 100.00%

Text address	Long text	Current value	Unit	Current state	Value range 0%	Value range 100%	Ruler value	Ruler state
<input checked="" type="checkbox"/> HDR.1 LNER10 CF001 XG01	Flow: 1 Fish passage	724.06	l/s	Substituted	0.00	1000.00	714.35	Substituted